

20140120 2895400T

FIG. 1a

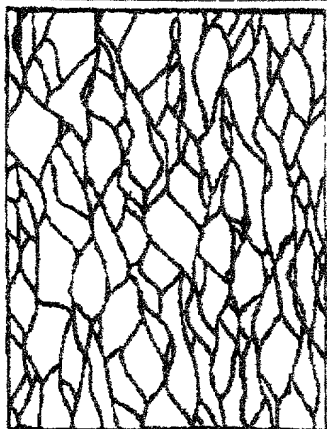


FIG. 1d

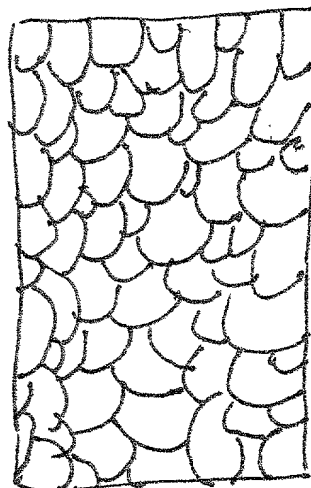


FIG. 1b

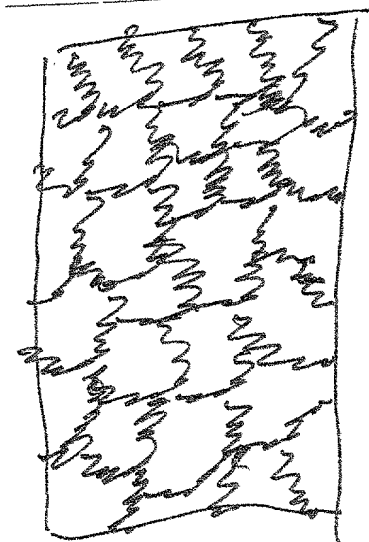


FIG. 1e

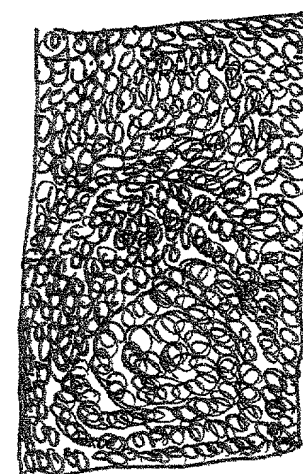


FIG. 1c

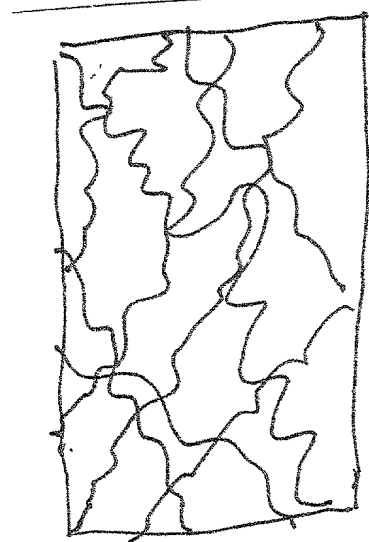


FIG. 1f


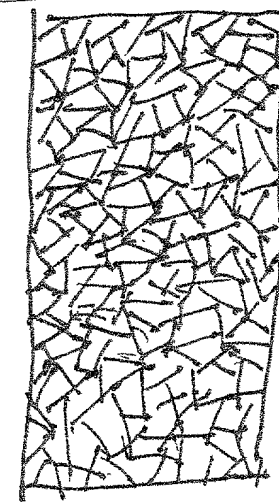


Fig 2a Uncoated MICROMESH




20110720 23252001

Fig 26 Uncoated MICROMESH

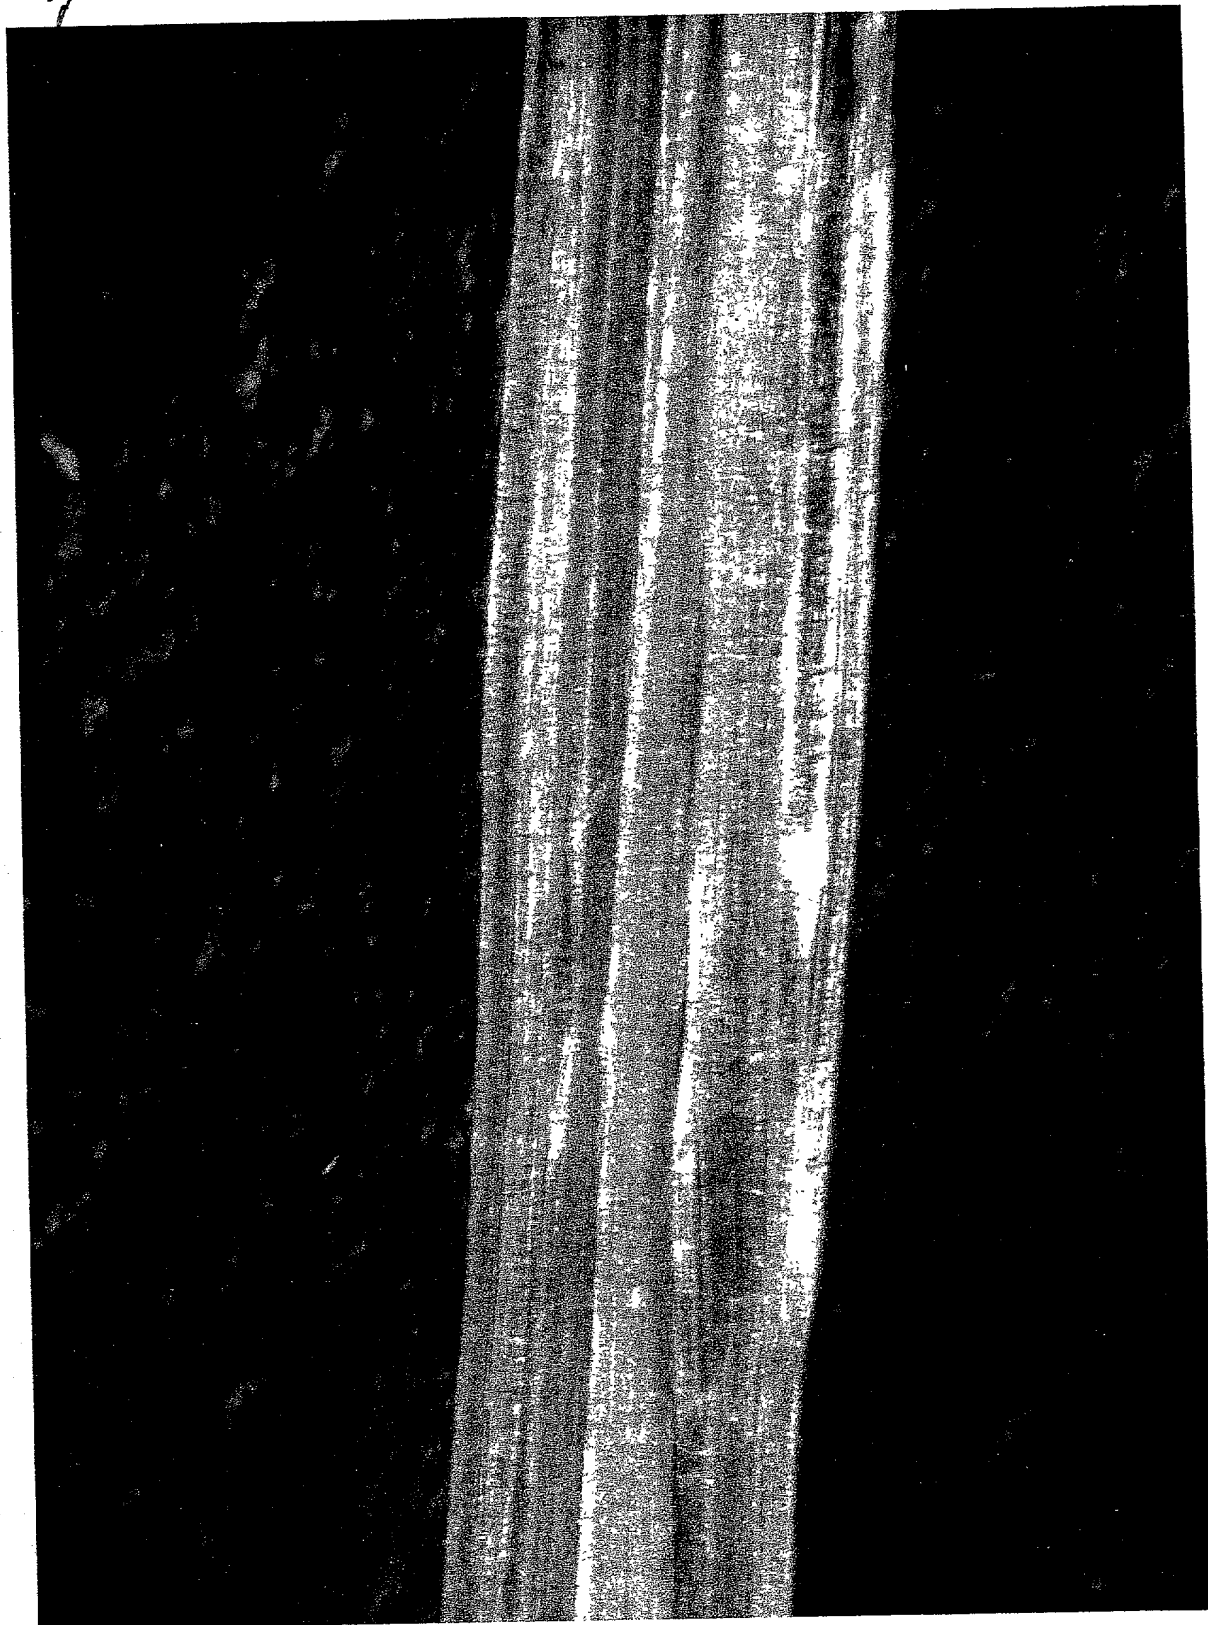


201720 289200T

Fig 2c Uncoated Micromesh

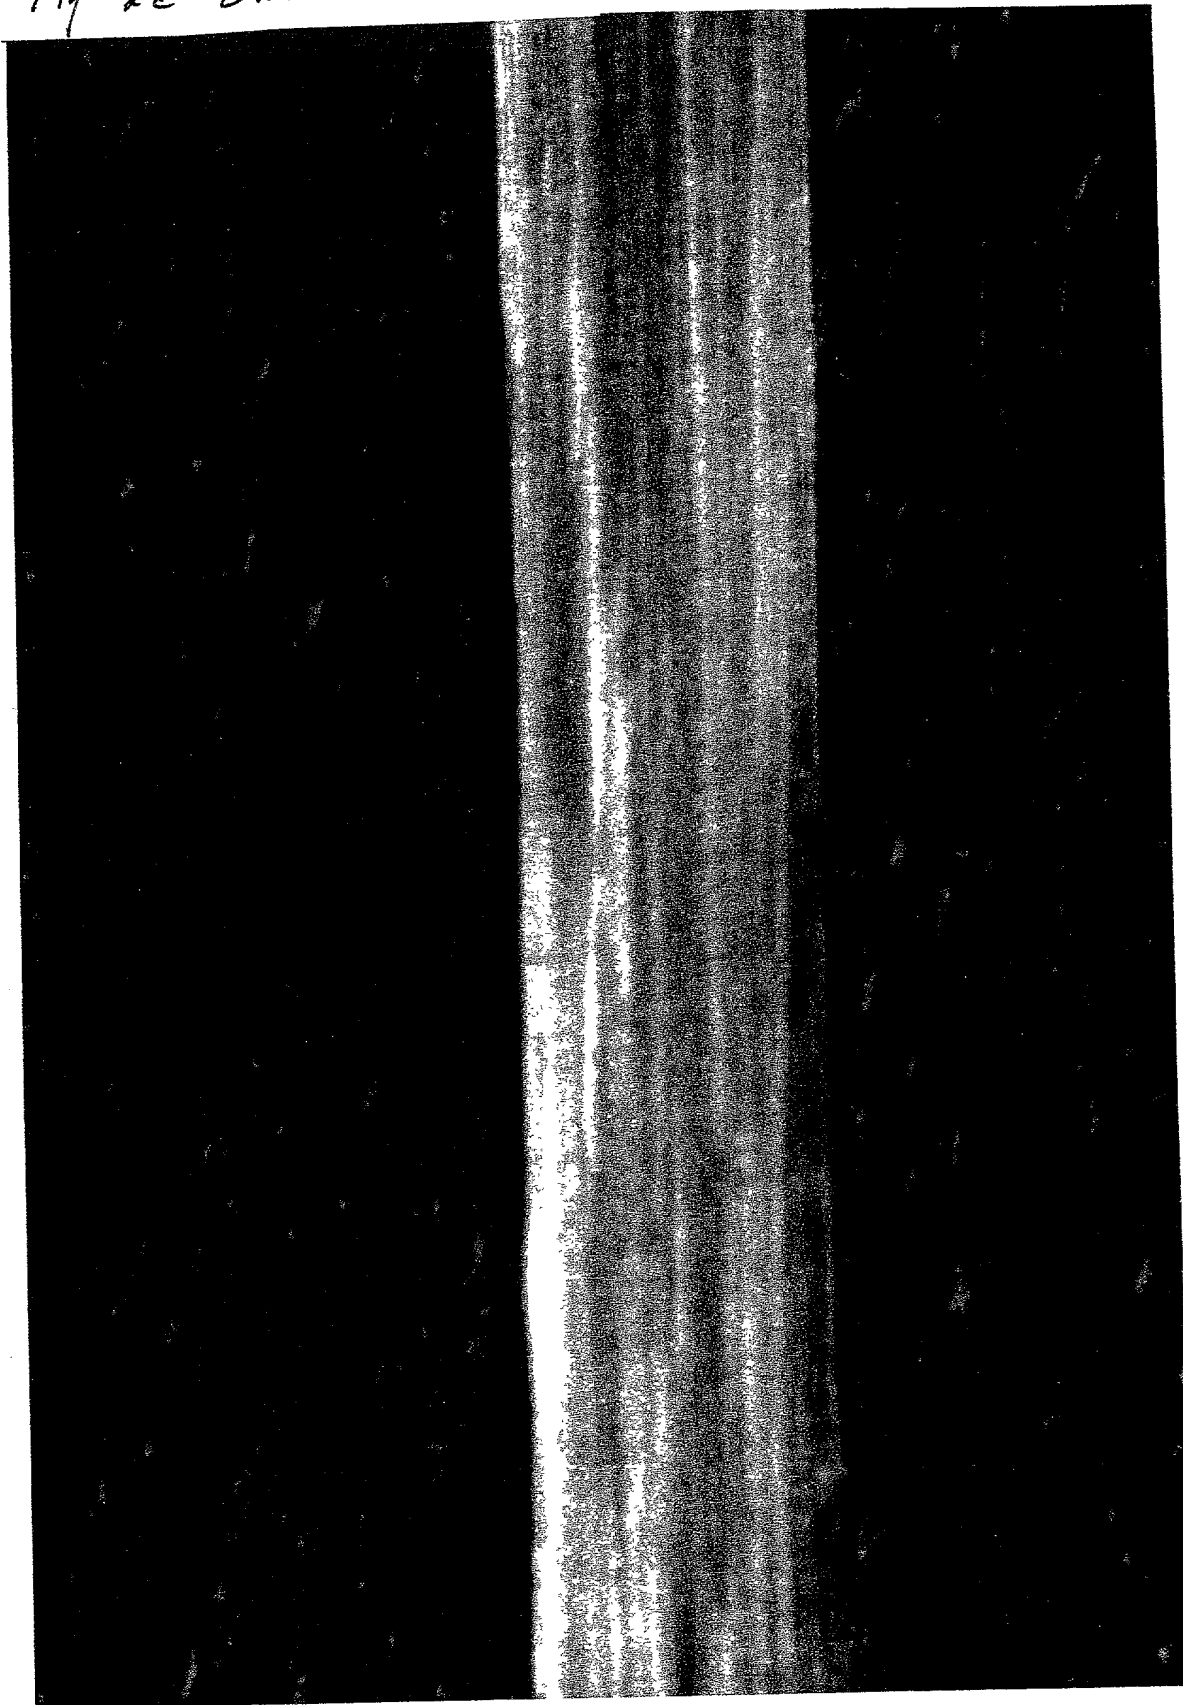

10073682-024102

Fig 2d Uncoated Monofilament Tape

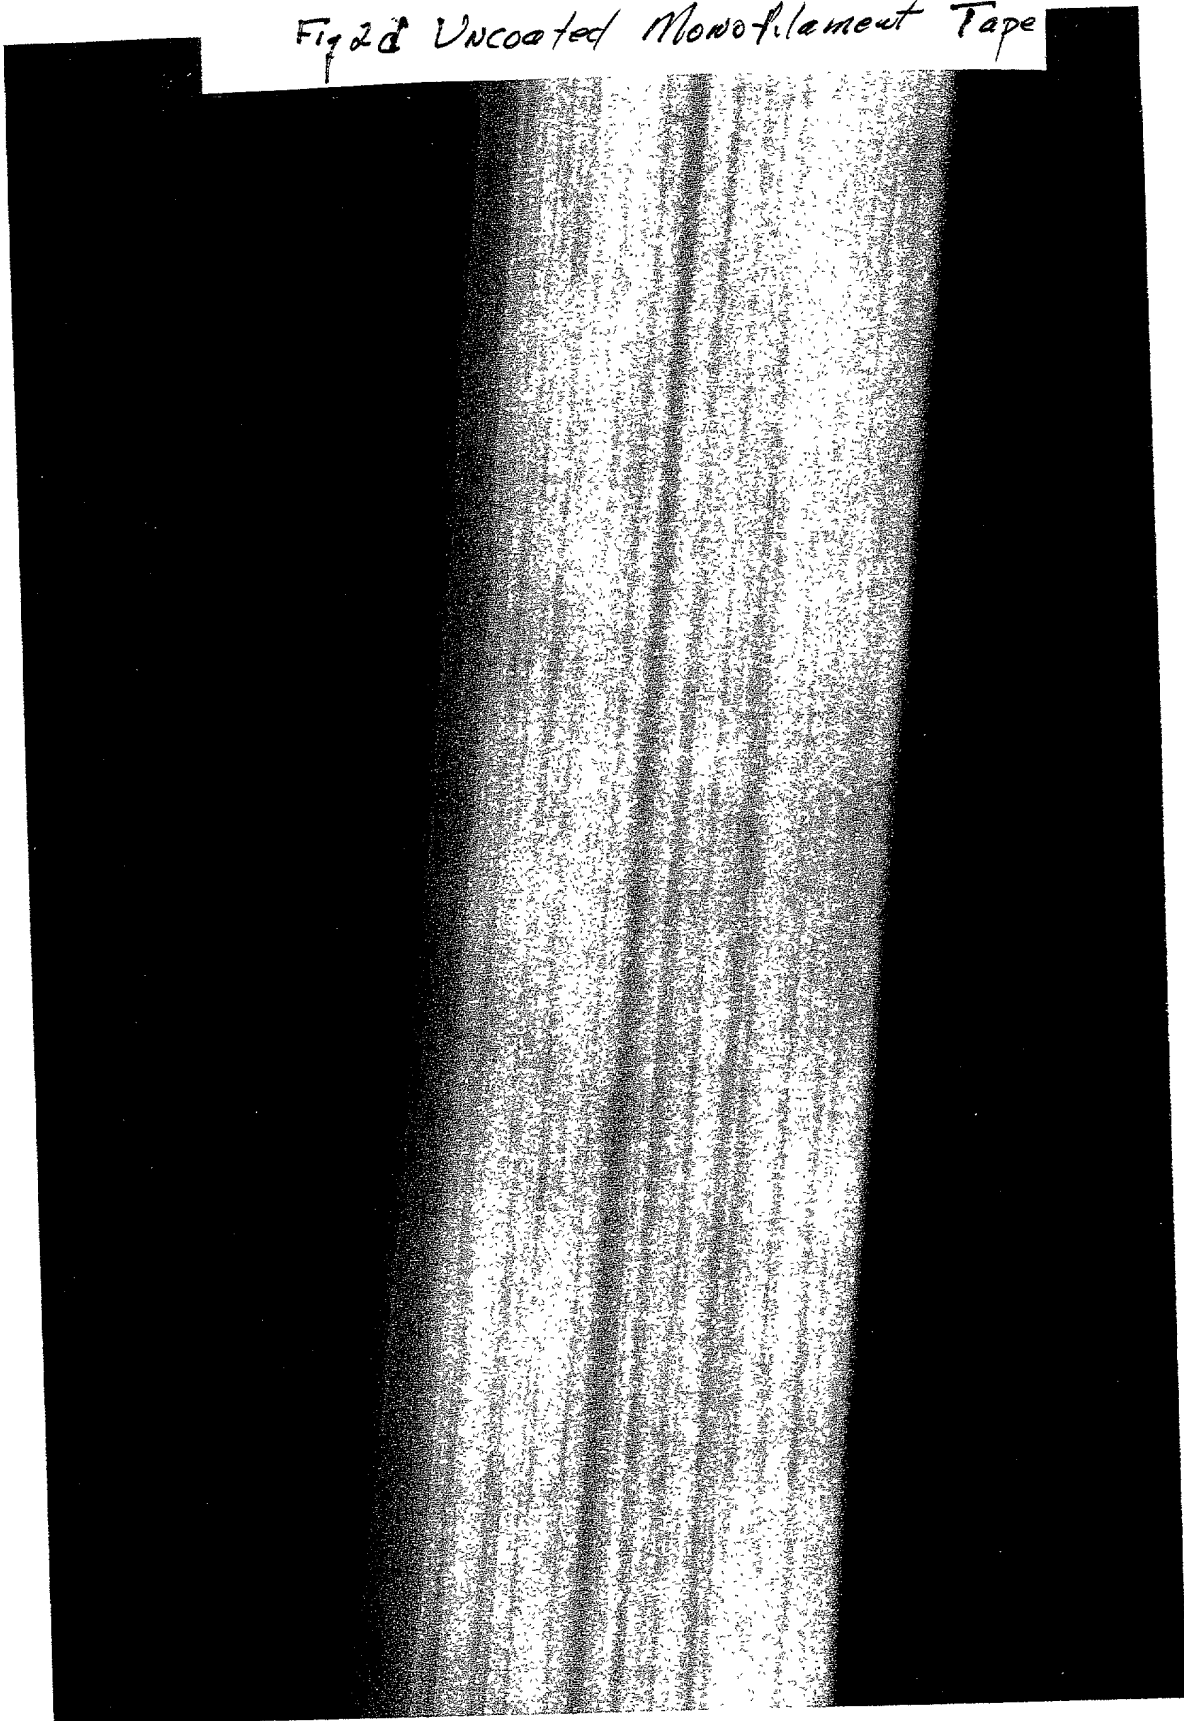


10073682.021103

A high-contrast, black and white image showing a vertical, textured strip of light gray material against a solid black background. The strip has a grainy, mottled appearance, possibly representing a film strip or a heavily textured surface. The top edge of the strip is slightly irregular and shows some dark, indistinct markings.

**THE**


Fig 3a MICROMESH Coated

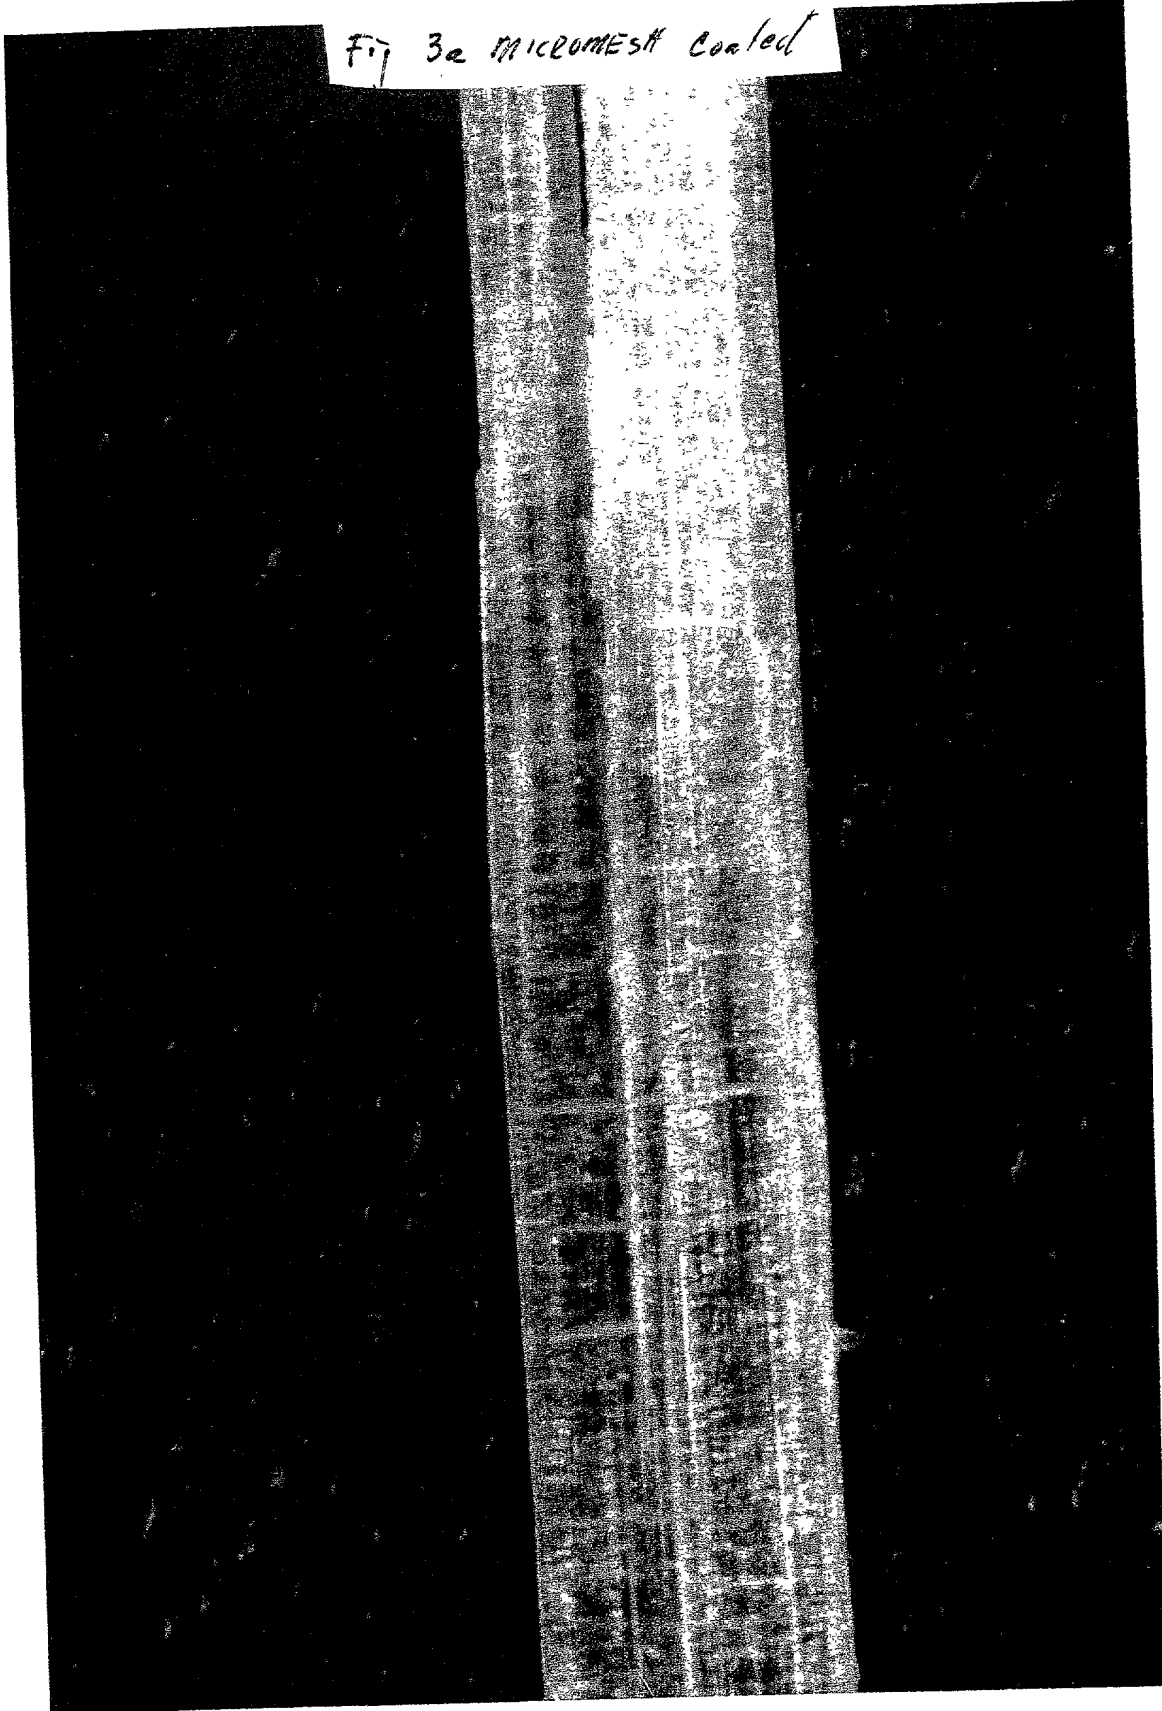

10073682.024102




Fig 36. Micromesh coated

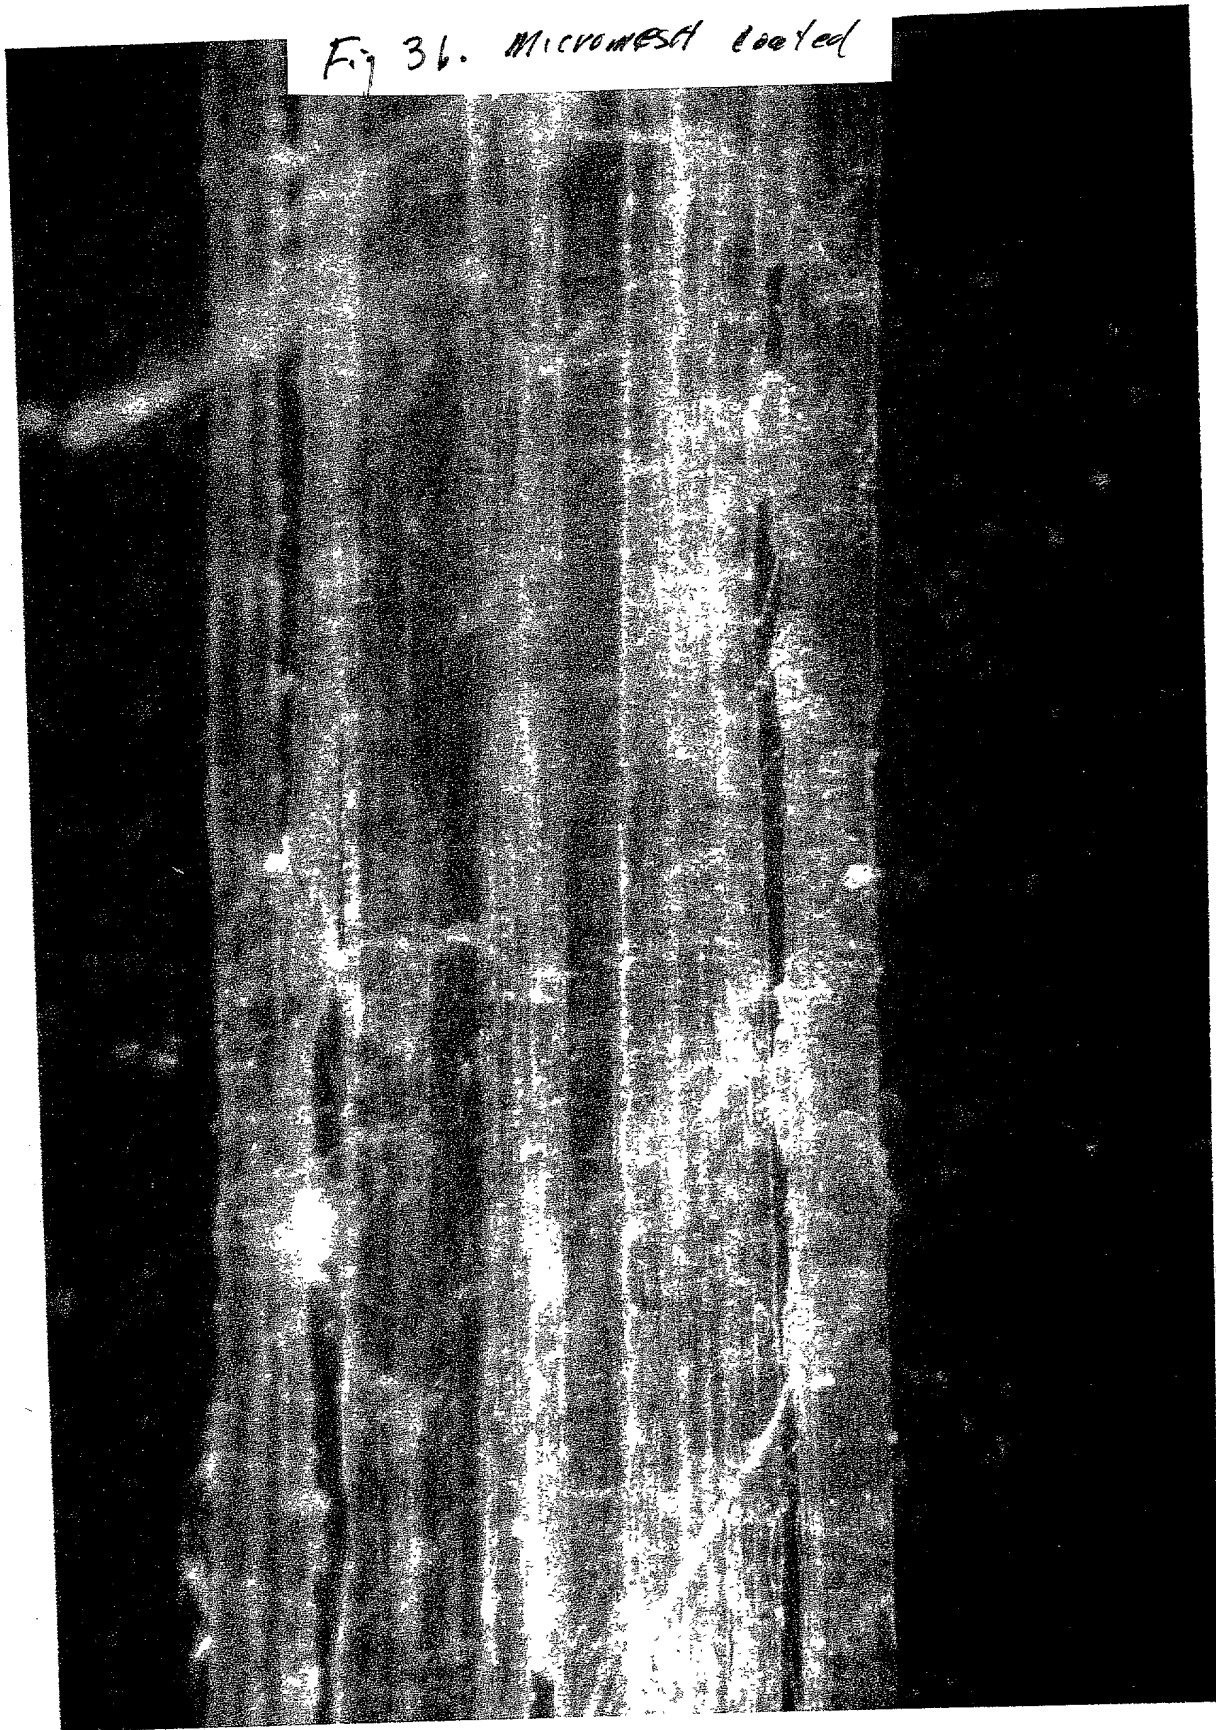

207420-28952007



Fig 4a Micromesh uncoated

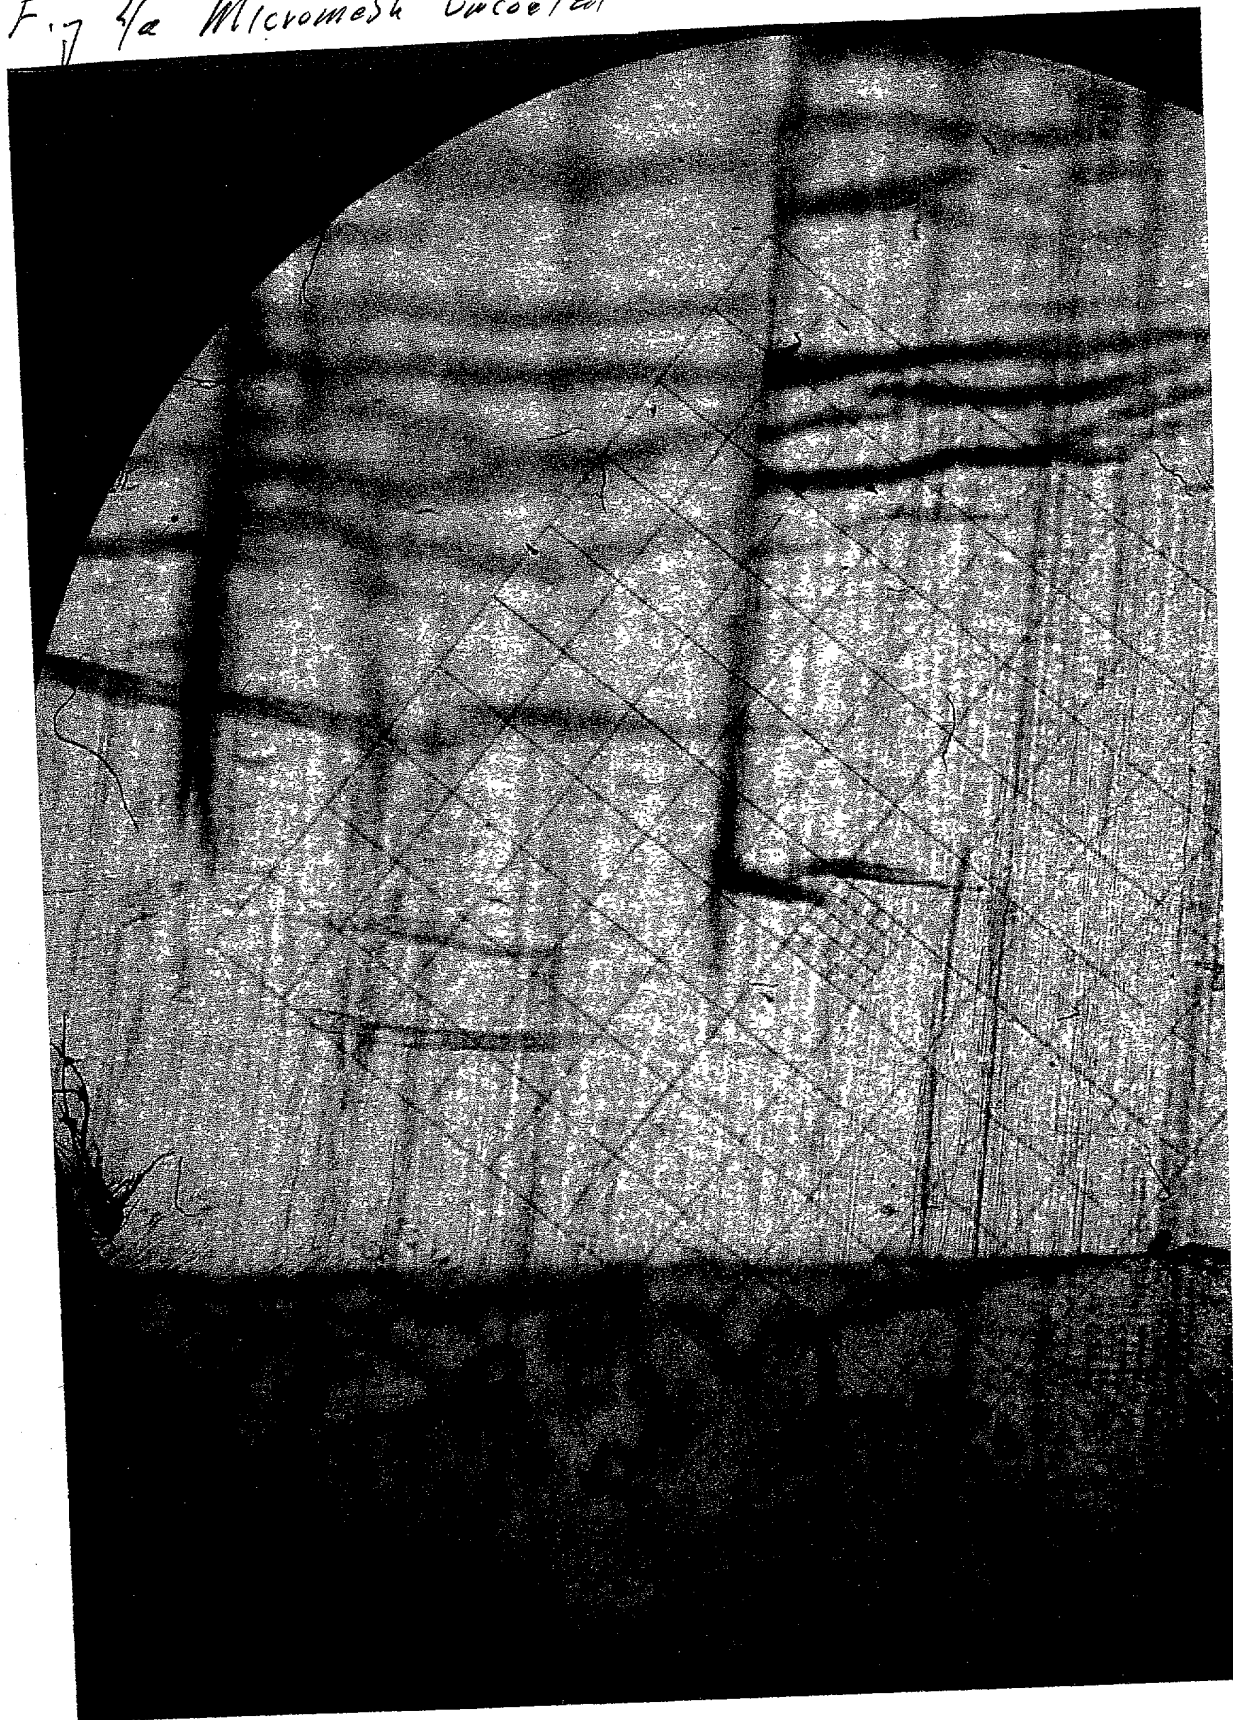

10073682-021102

10073682.024102

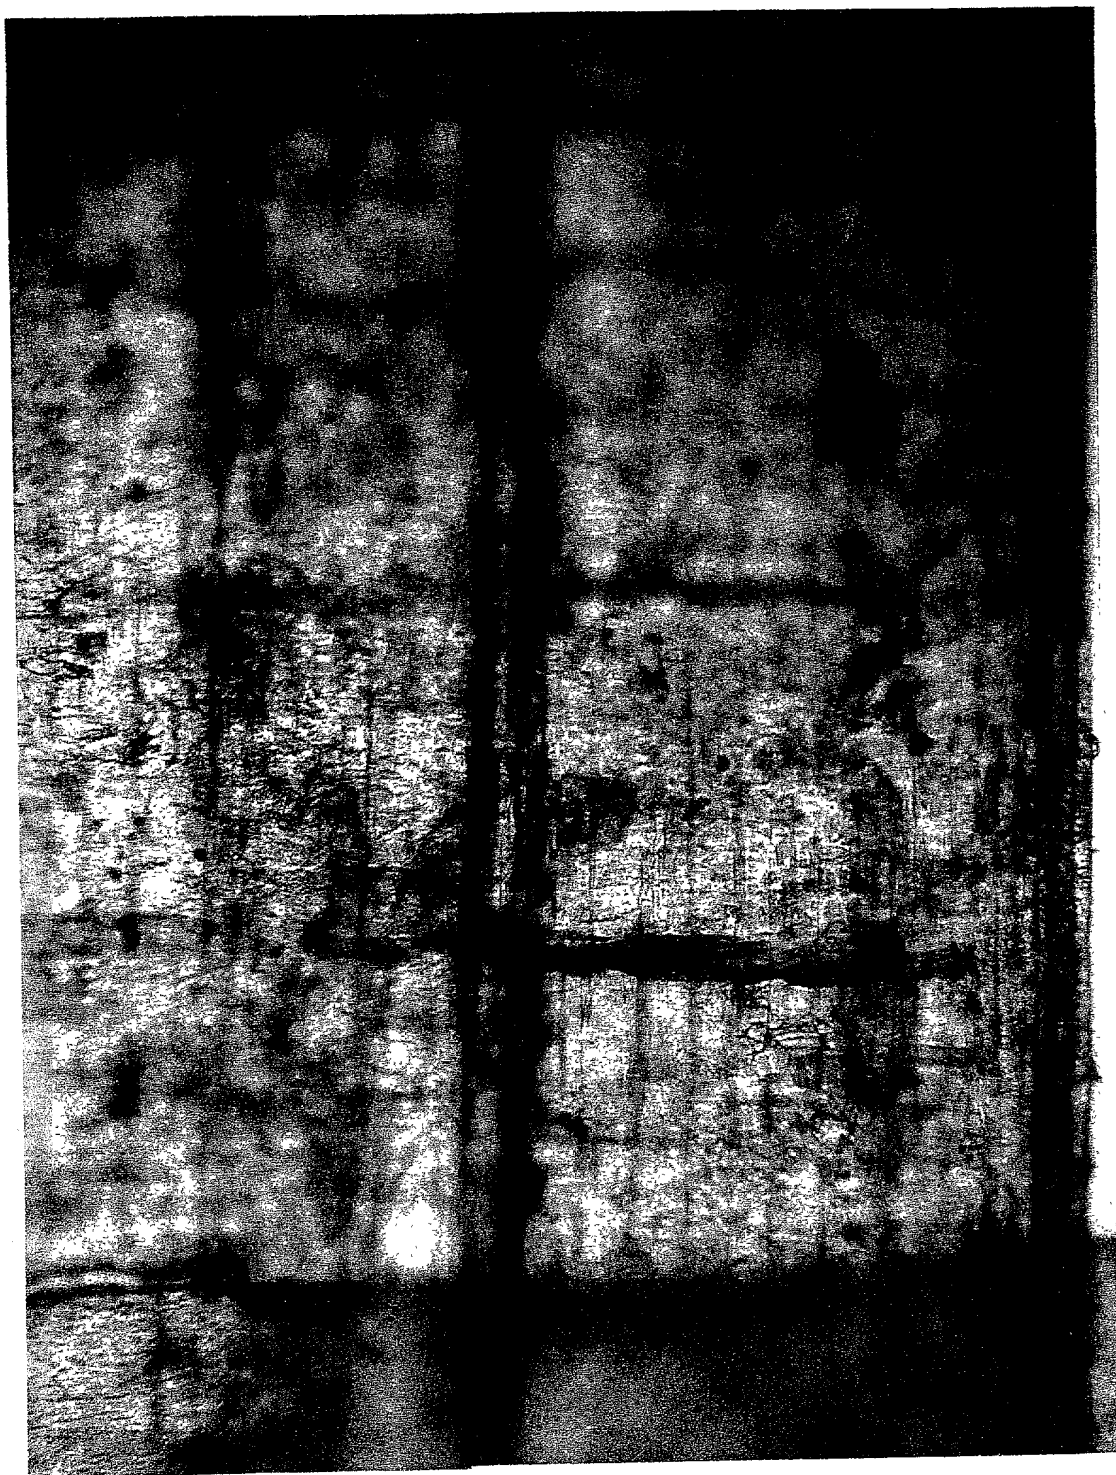


Fig 4/5 Micromesh coated

10073682.024102

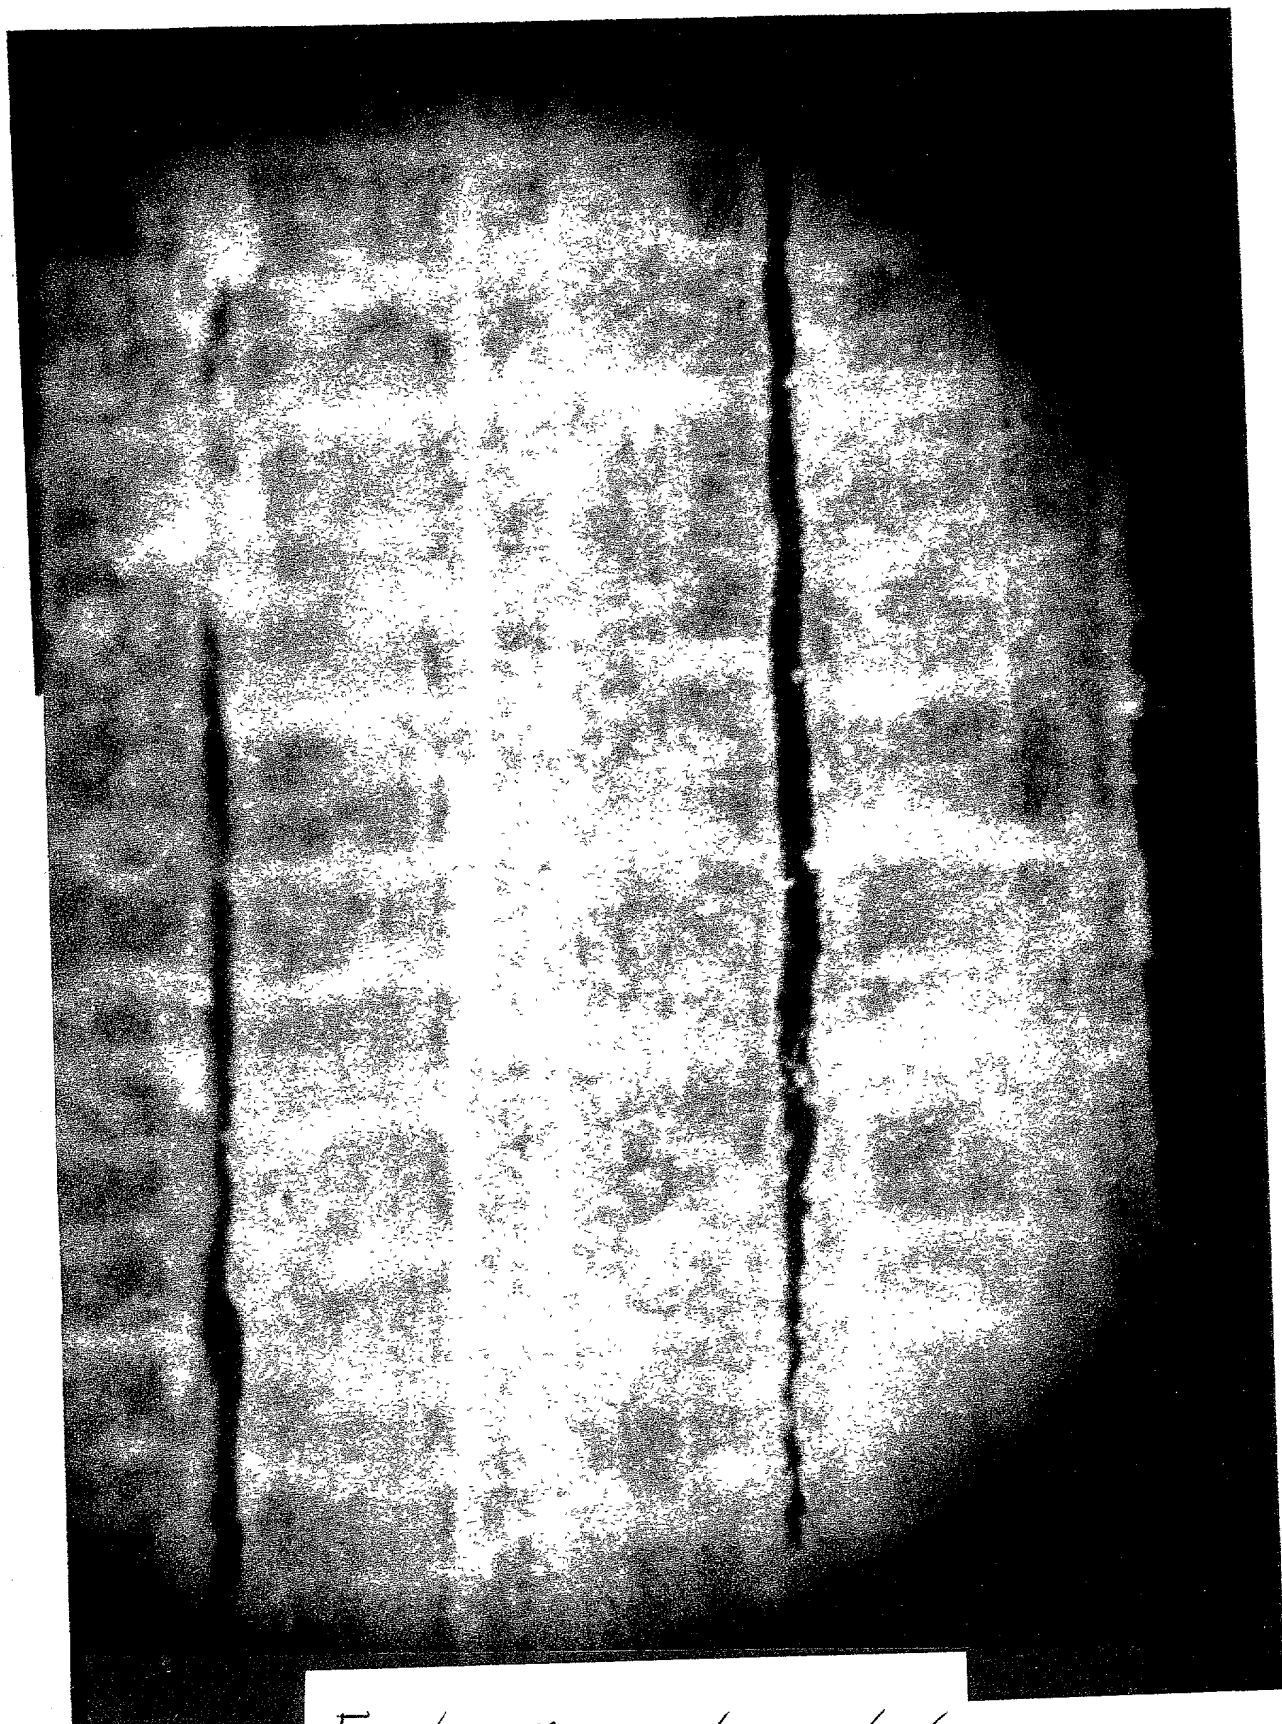


Fig 4/c Micromesh coated

FIG. 5




FIG. 6

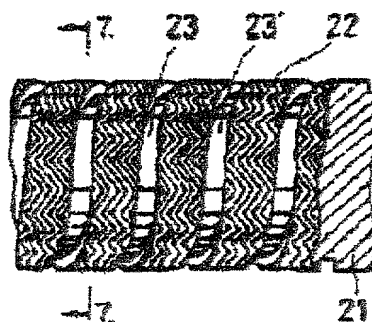


FIG. 7

Schematic Drawing:  
Physical disruption of biofilm and tartar by flossing  
with a micromesh polyethylene tape compression loaded  
with a coating containing Gentle Abrasives™ and Cleaners



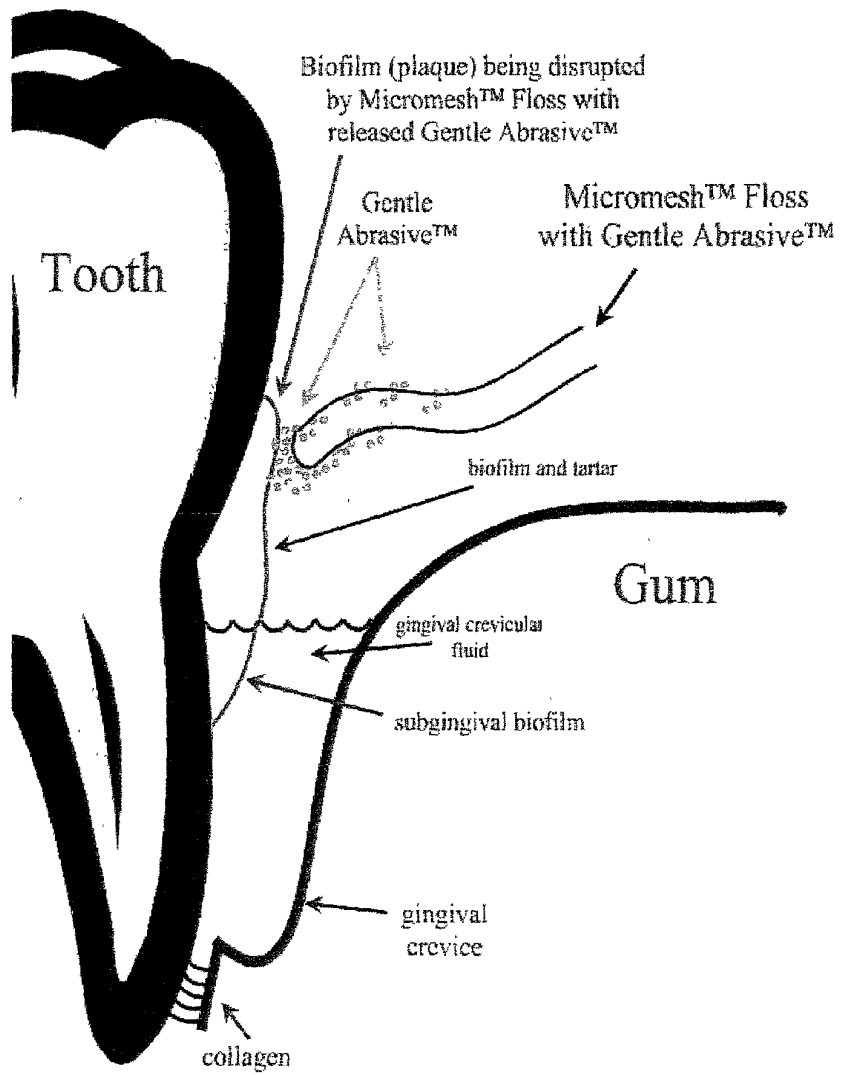


FIG. 7A

Schematic Drawing:


Physical disruption of biofilm and tartar by flossing with a micromesh polyethylene interproximal device compression loaded with a high melt viscosity emulsion, where the dislodged biofilm and other substances are entrapped and removed from interproximal and subgingival areas by the device

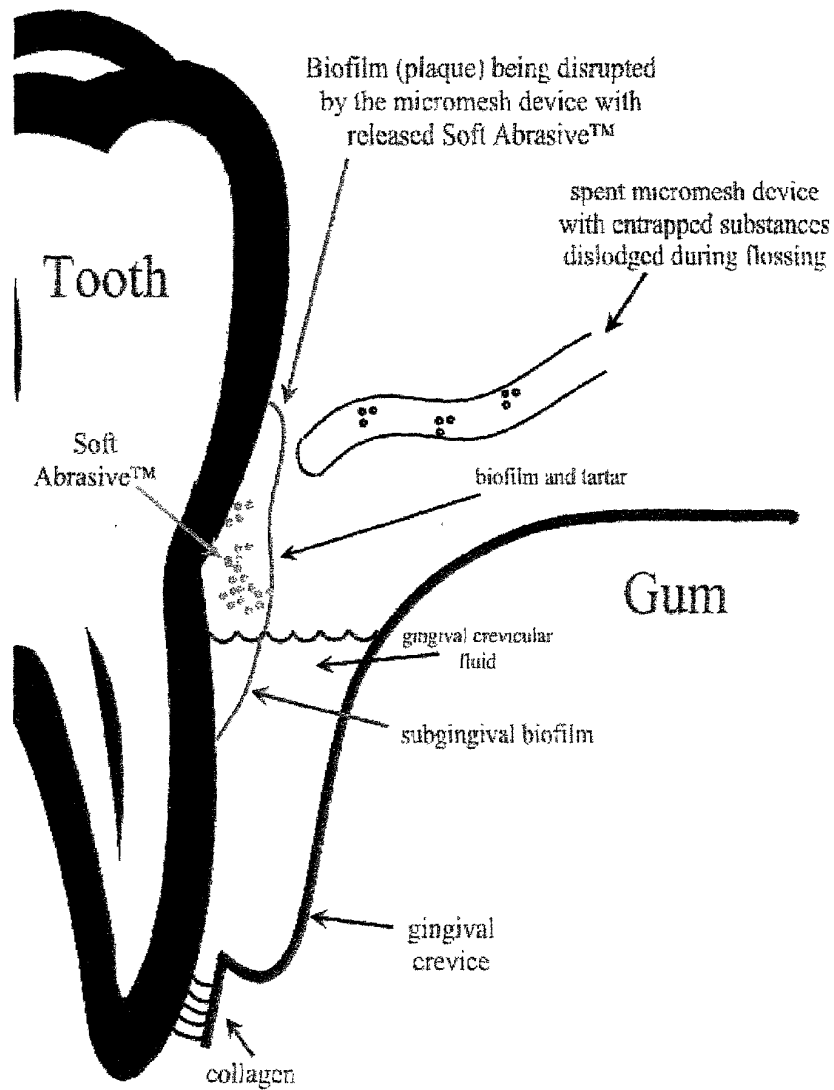

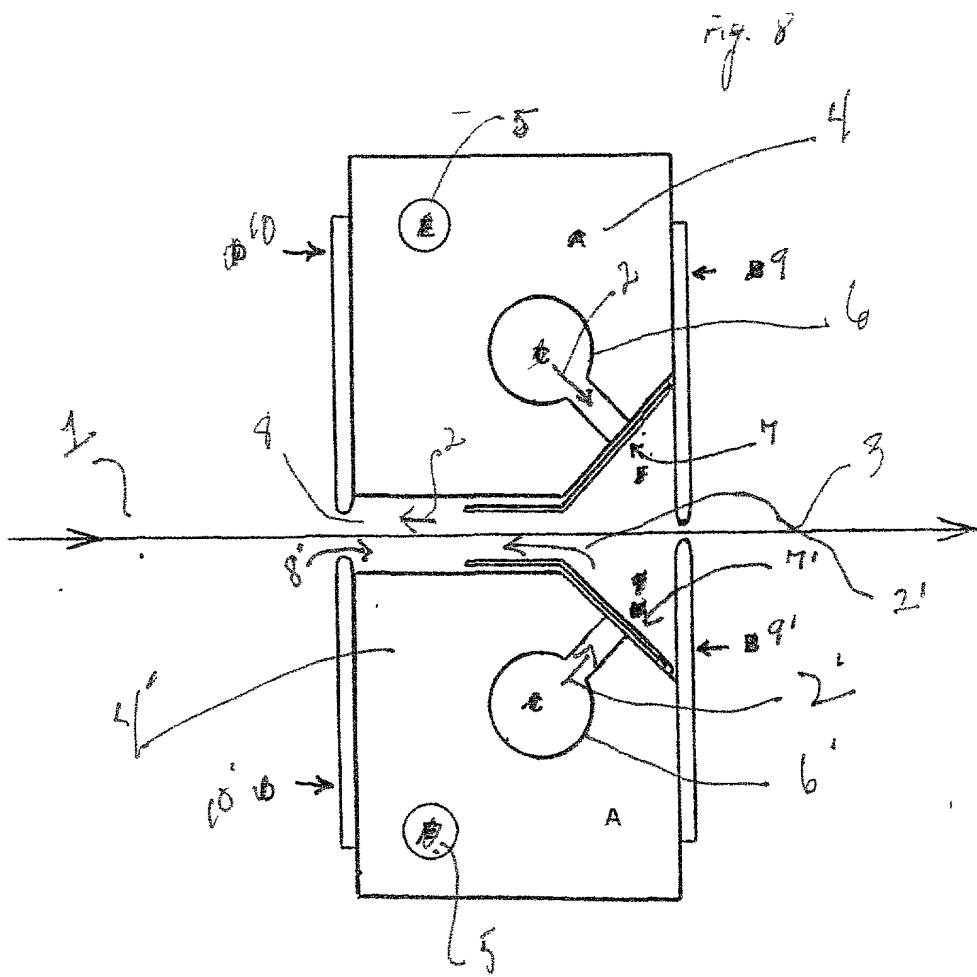



11  
6

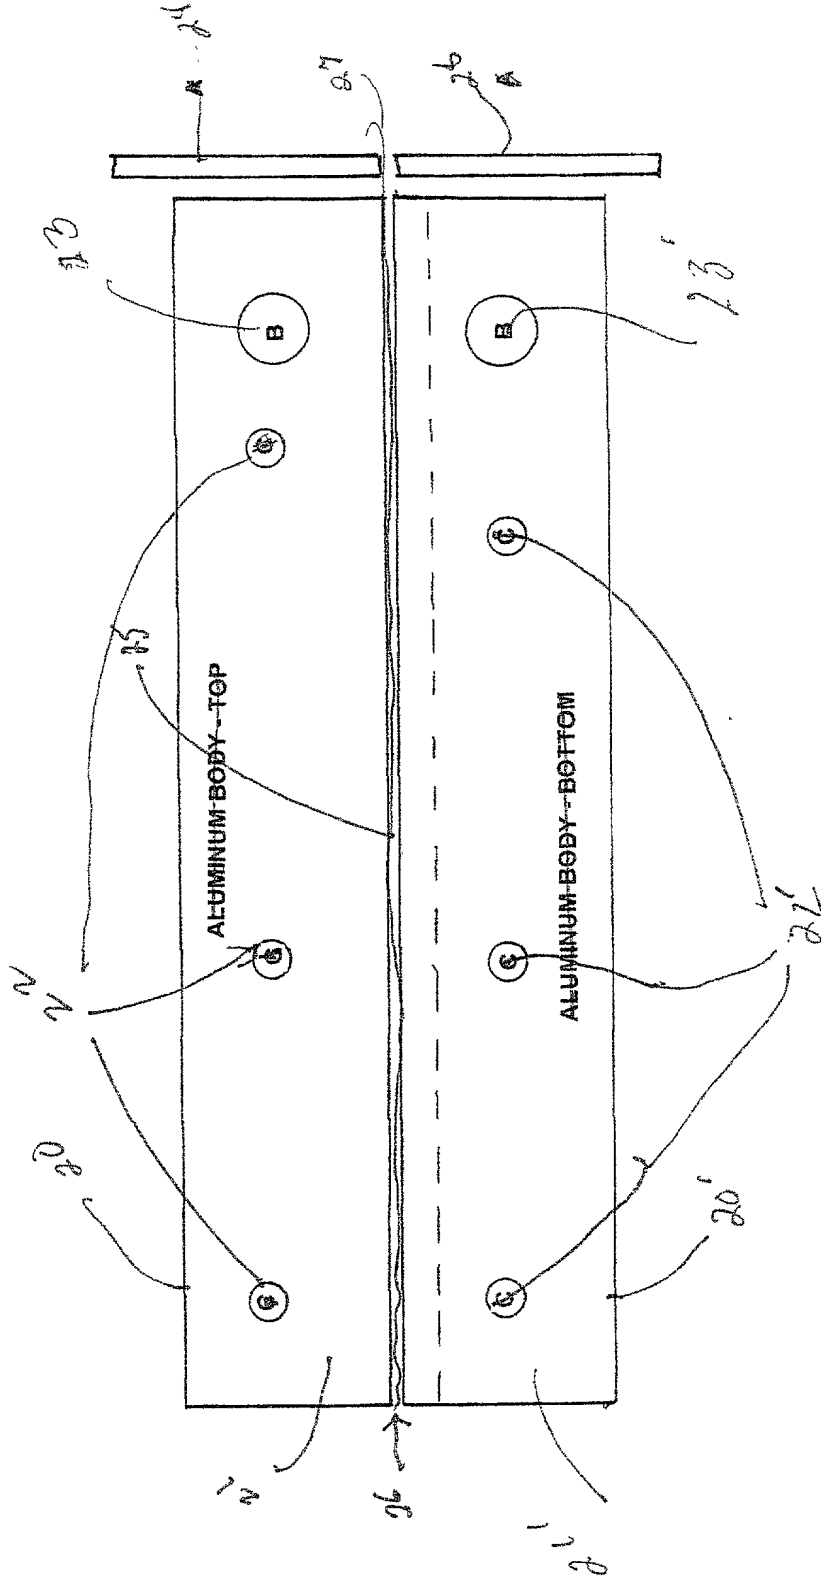

10073682.021.102


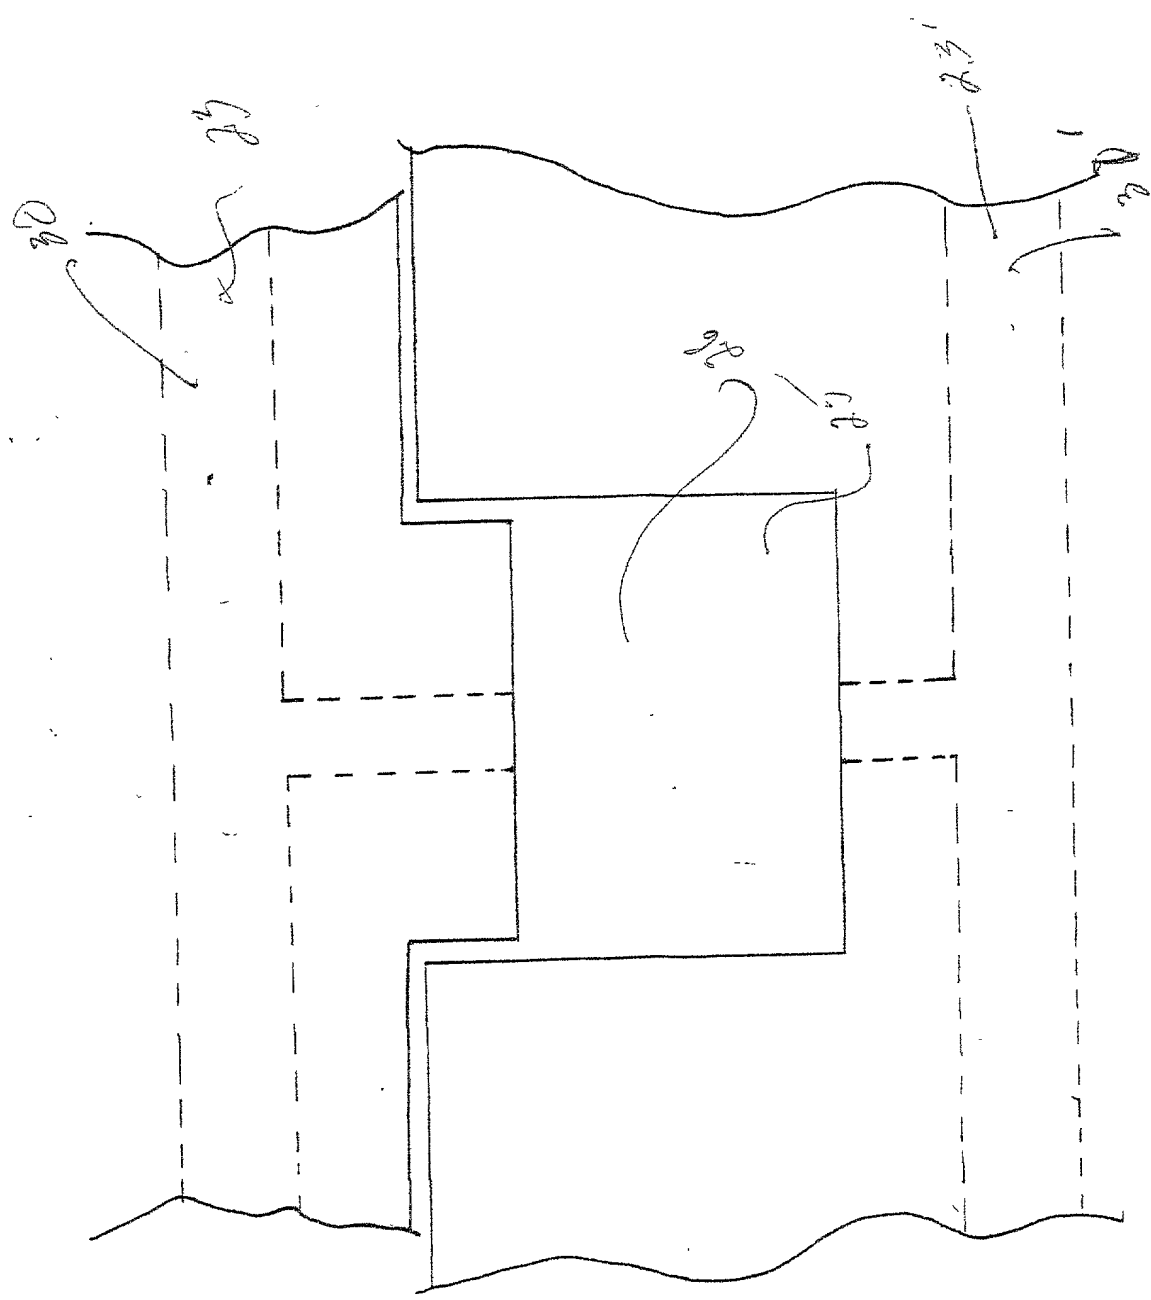


Fig 10

Fig 11

40

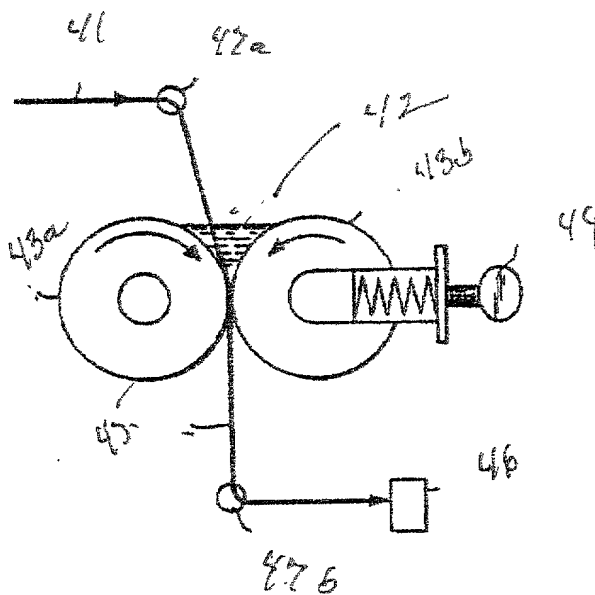

10073633-024102

Fig. 12

